


PLAN VIEW

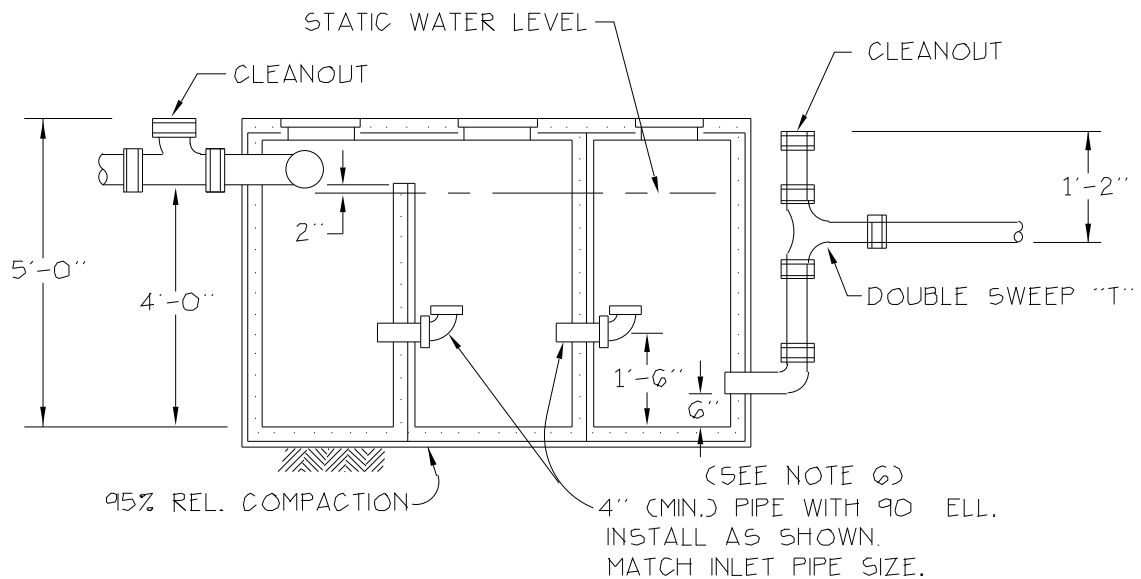

SECTION

NOTES:

1. DIMENSIONS SHOWN ARE FOR MINIMUM SIZE (750 GALLON) TRAP.
2. EACH UNIT SHALL BE DESIGNED BY A REGISTERED CIVIL ENGINEER AND APPROVED BY THE CITY ENGINEER. STREET INSTALLATIONS SHALL BE DESIGNED FOR H-20 LOADING.
3. CONCRETE SHALL BE A MINIMUM OF 3,000 PSI AT 28 DAYS.
4. ALL WASTE SHALL ENTER TRAP THROUGH INLET PIPE ONLY.
5. COVERS SHALL BE STEEL AND GAS TIGHT.
6. EFFLUENT PIPE SHALL EXIT TANK 6" FROM BOTTOM.

| REV. NO. | REV. DATE | REV. BY. | TYPICAL SAND & OIL TRAP | | REVISION APPROVED BY CITY ENGINEER | |
|------------------|-----------|----------|--|--|-------------------------------------|-------------------|
| 3 | 2/23/95 | KB/DE | | | DATE: | |
| DIGITIZED 1/1/92 | | | CITY OF STOCKTON DEPARTMENT OF PUBLIC WORKS | | SUPERCEDES DWC. DATED 11/8/80 | DRAWING NO. 66 |
| DWC. BY | RC | SCALE | | | | |
| CK. BY | | NONE | | | | |